Installations Guide for Selection Series

MISTEC®
MISTING TECHNOLOGIES

WWW.MISTING-SYSTEMS.COM

Mounting layout example
Polyamide pipes line
and Premium pump

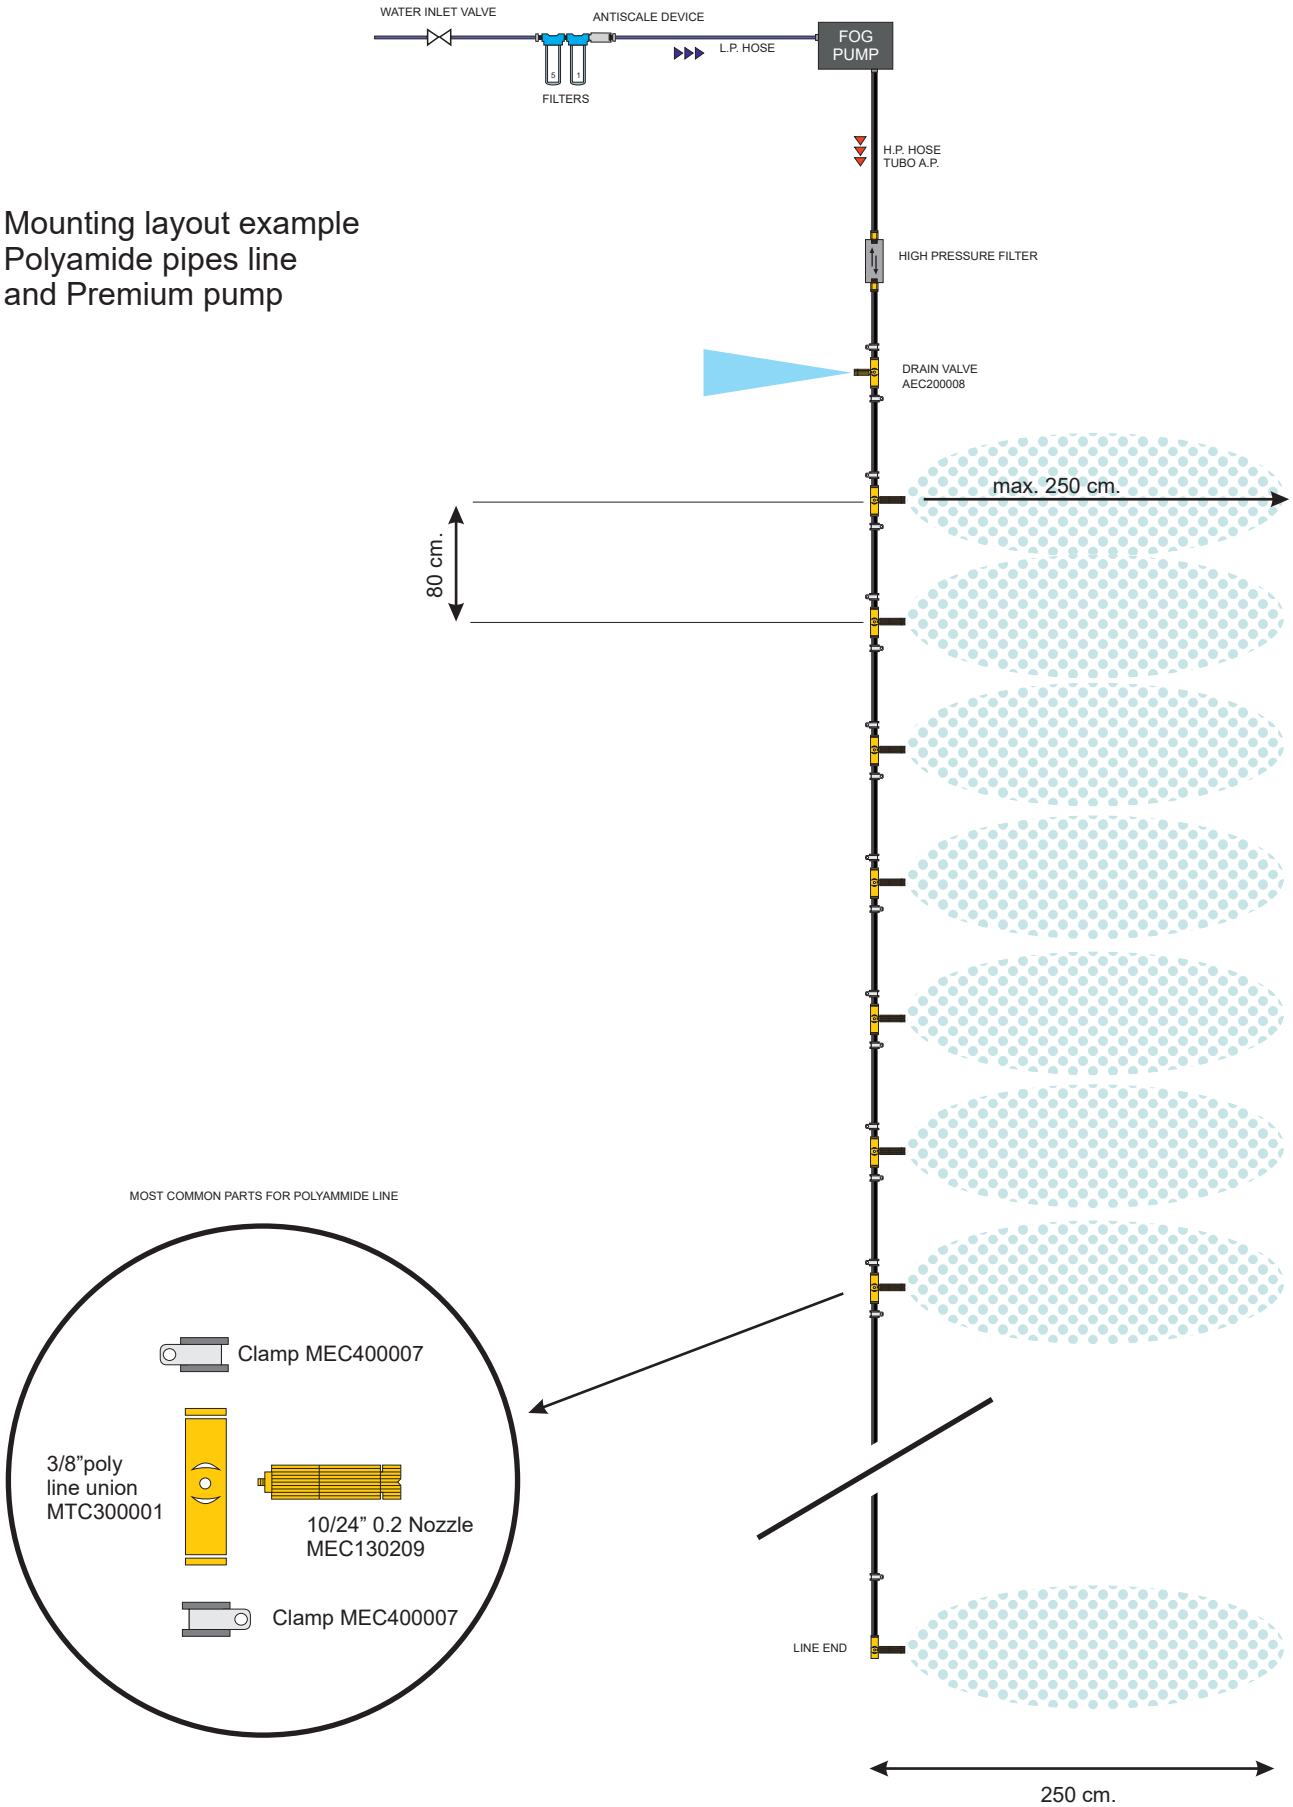

Mounting layout example



1) Fans should be mounted 7 meters far from each other and no more than 10 meters
2) Fans must be mounted at 240/300 cm. height from floor

MEC600001 cooling fans with polyamide pipeline

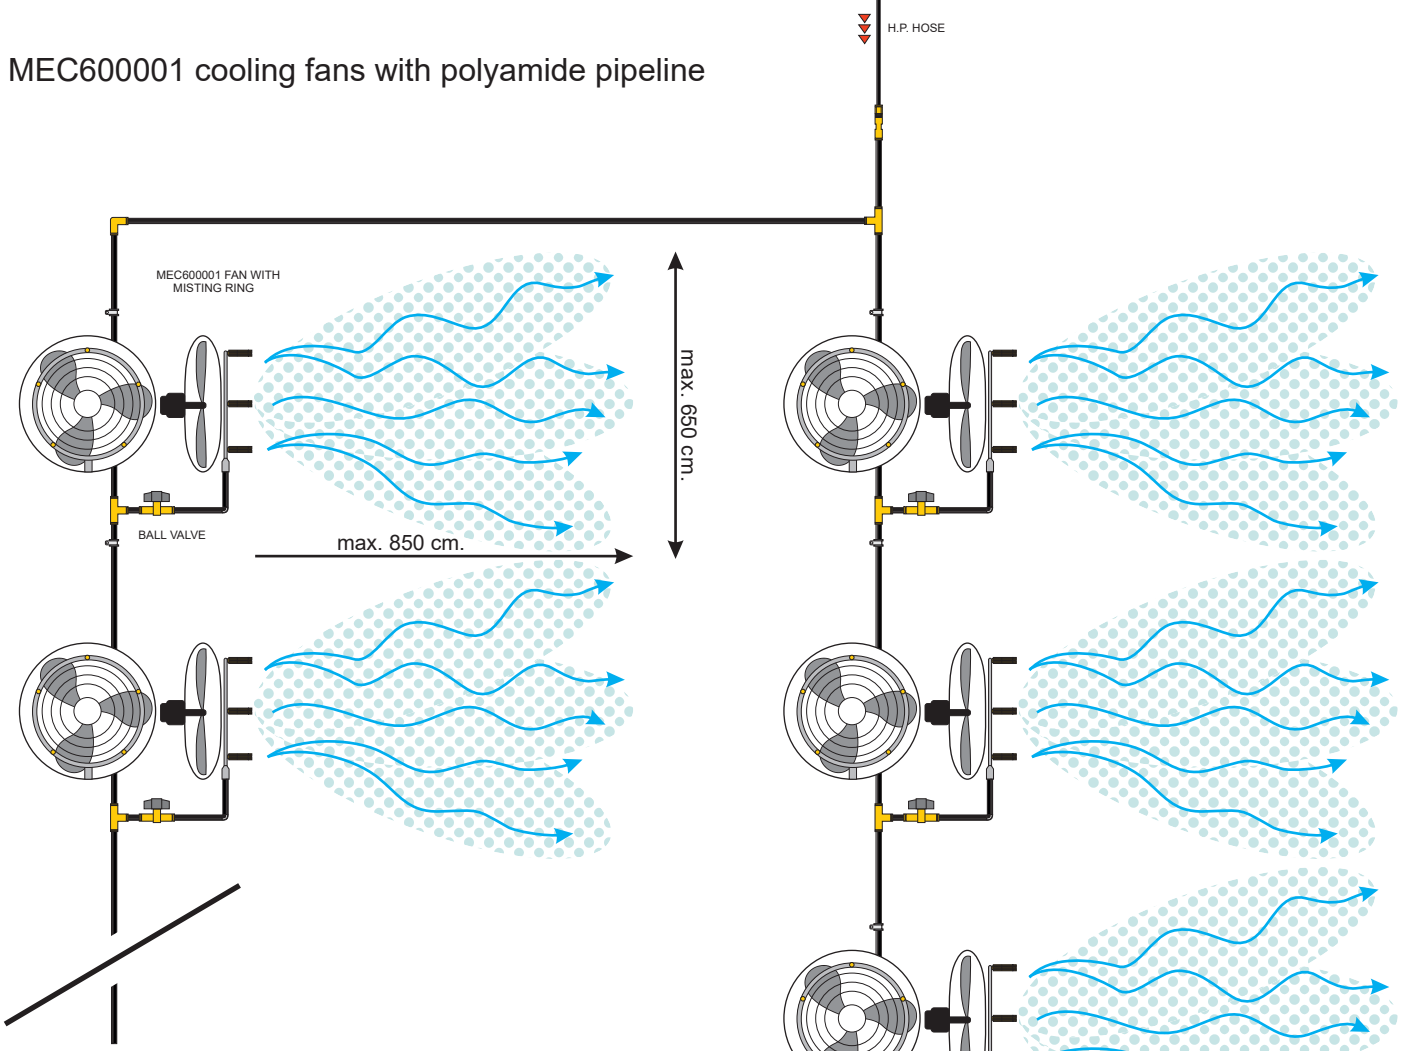

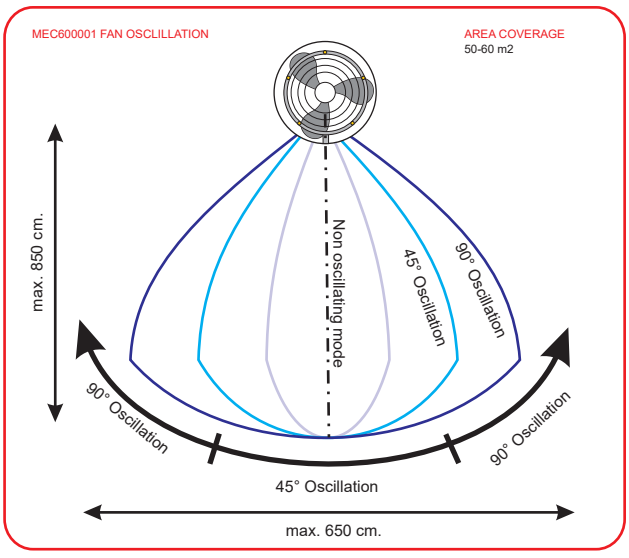



Mounting layout example

1) Fans should be mounted 4 meters far from each other and no more than 8 meters
2) Fans must be mounted at 230/300 cm. height from floor
3) Install misting ring with 5 mm pipe for better oscillation

MTC600041 cooling fans with polyamide pipeline

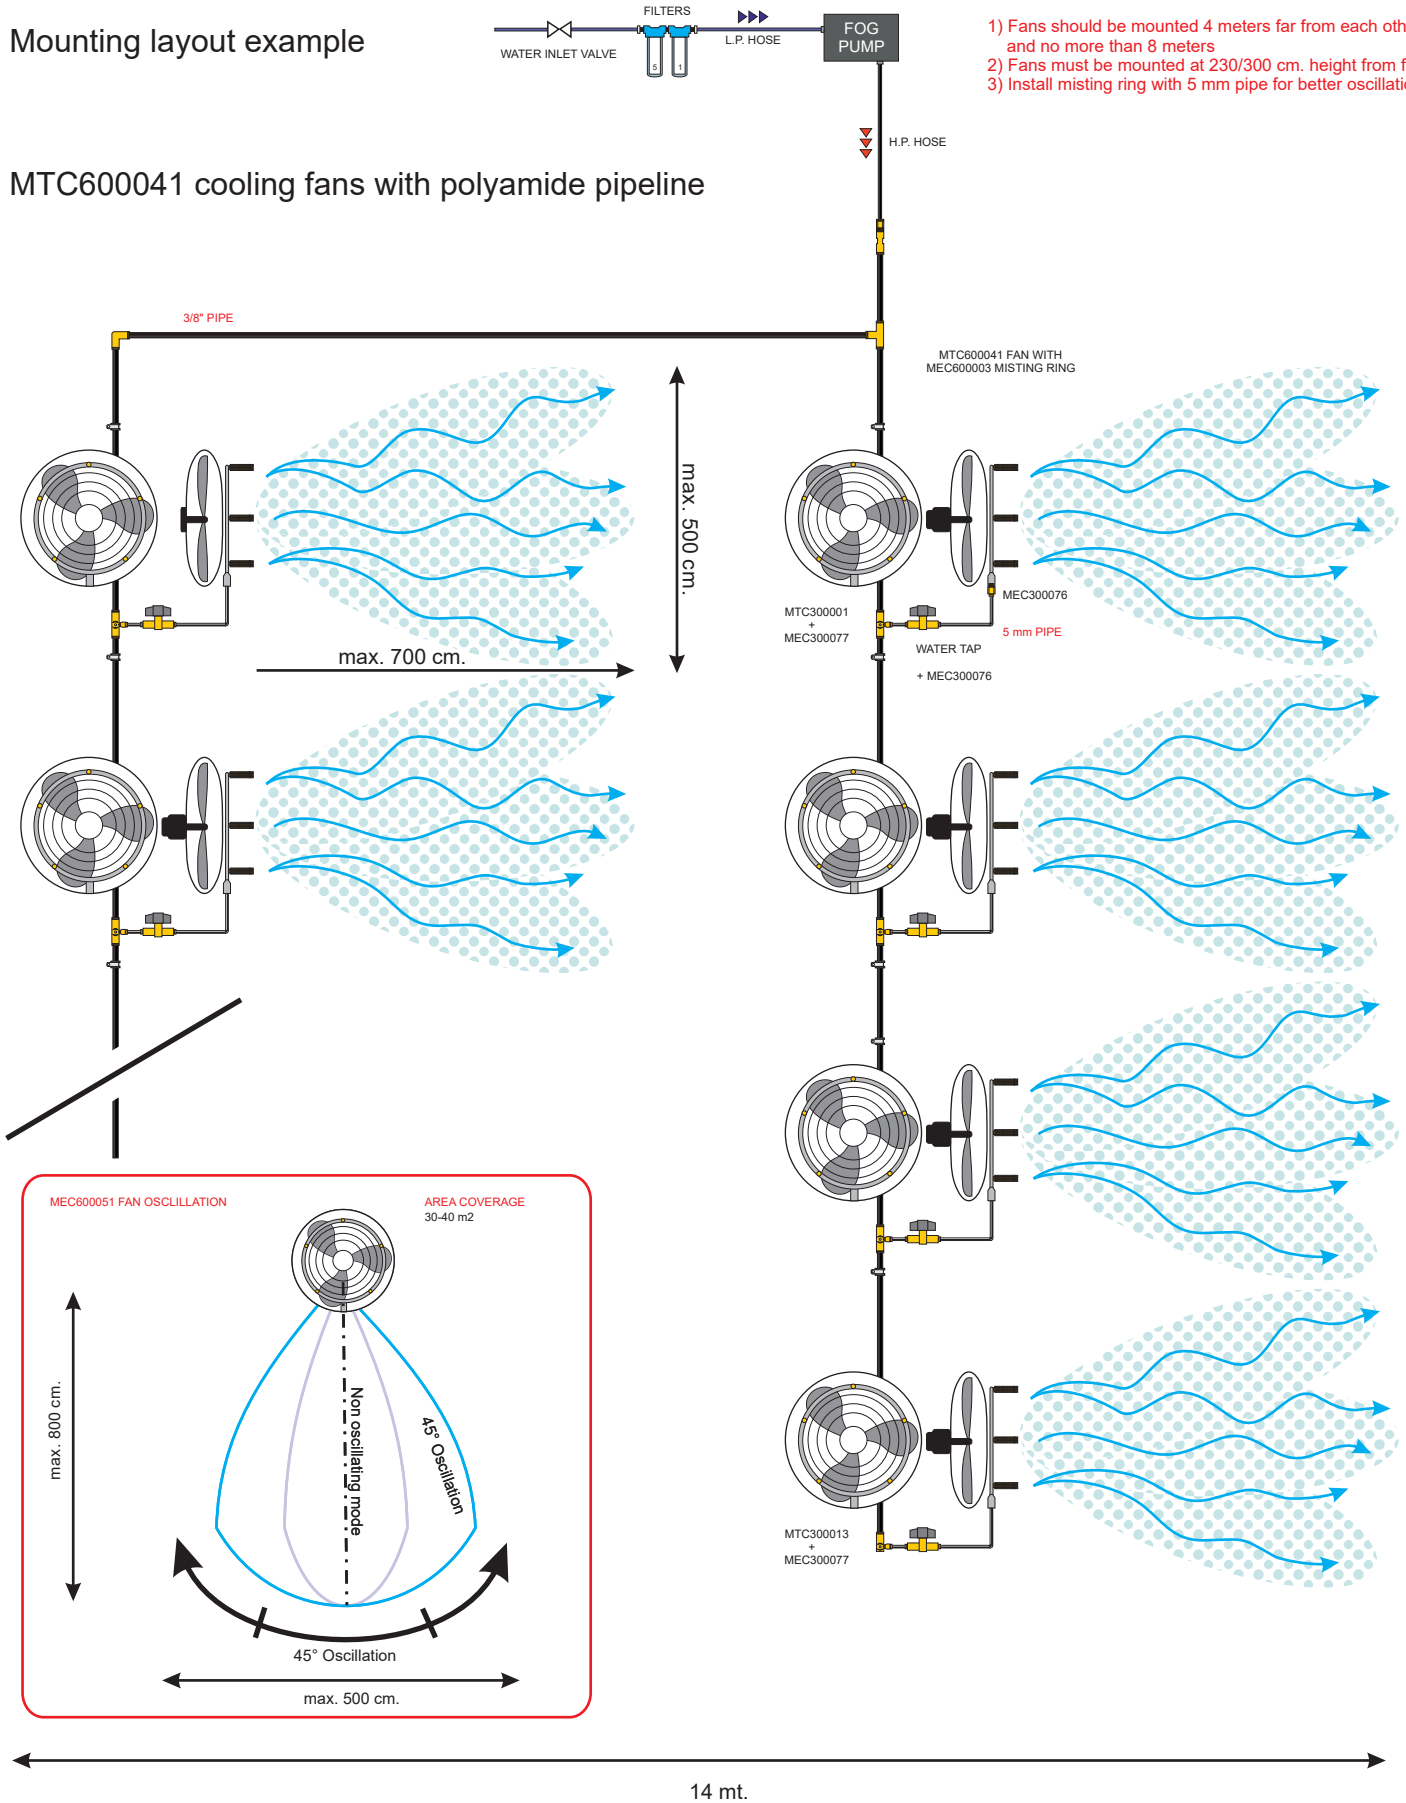

Mounting layout example



1) Fans should be mounted 4 meters far from each other and no more than 8 meters
2) Fans must be mounted at 240/300 cm. height from floor

MEC600050 cooling fans with polyamide pipeline

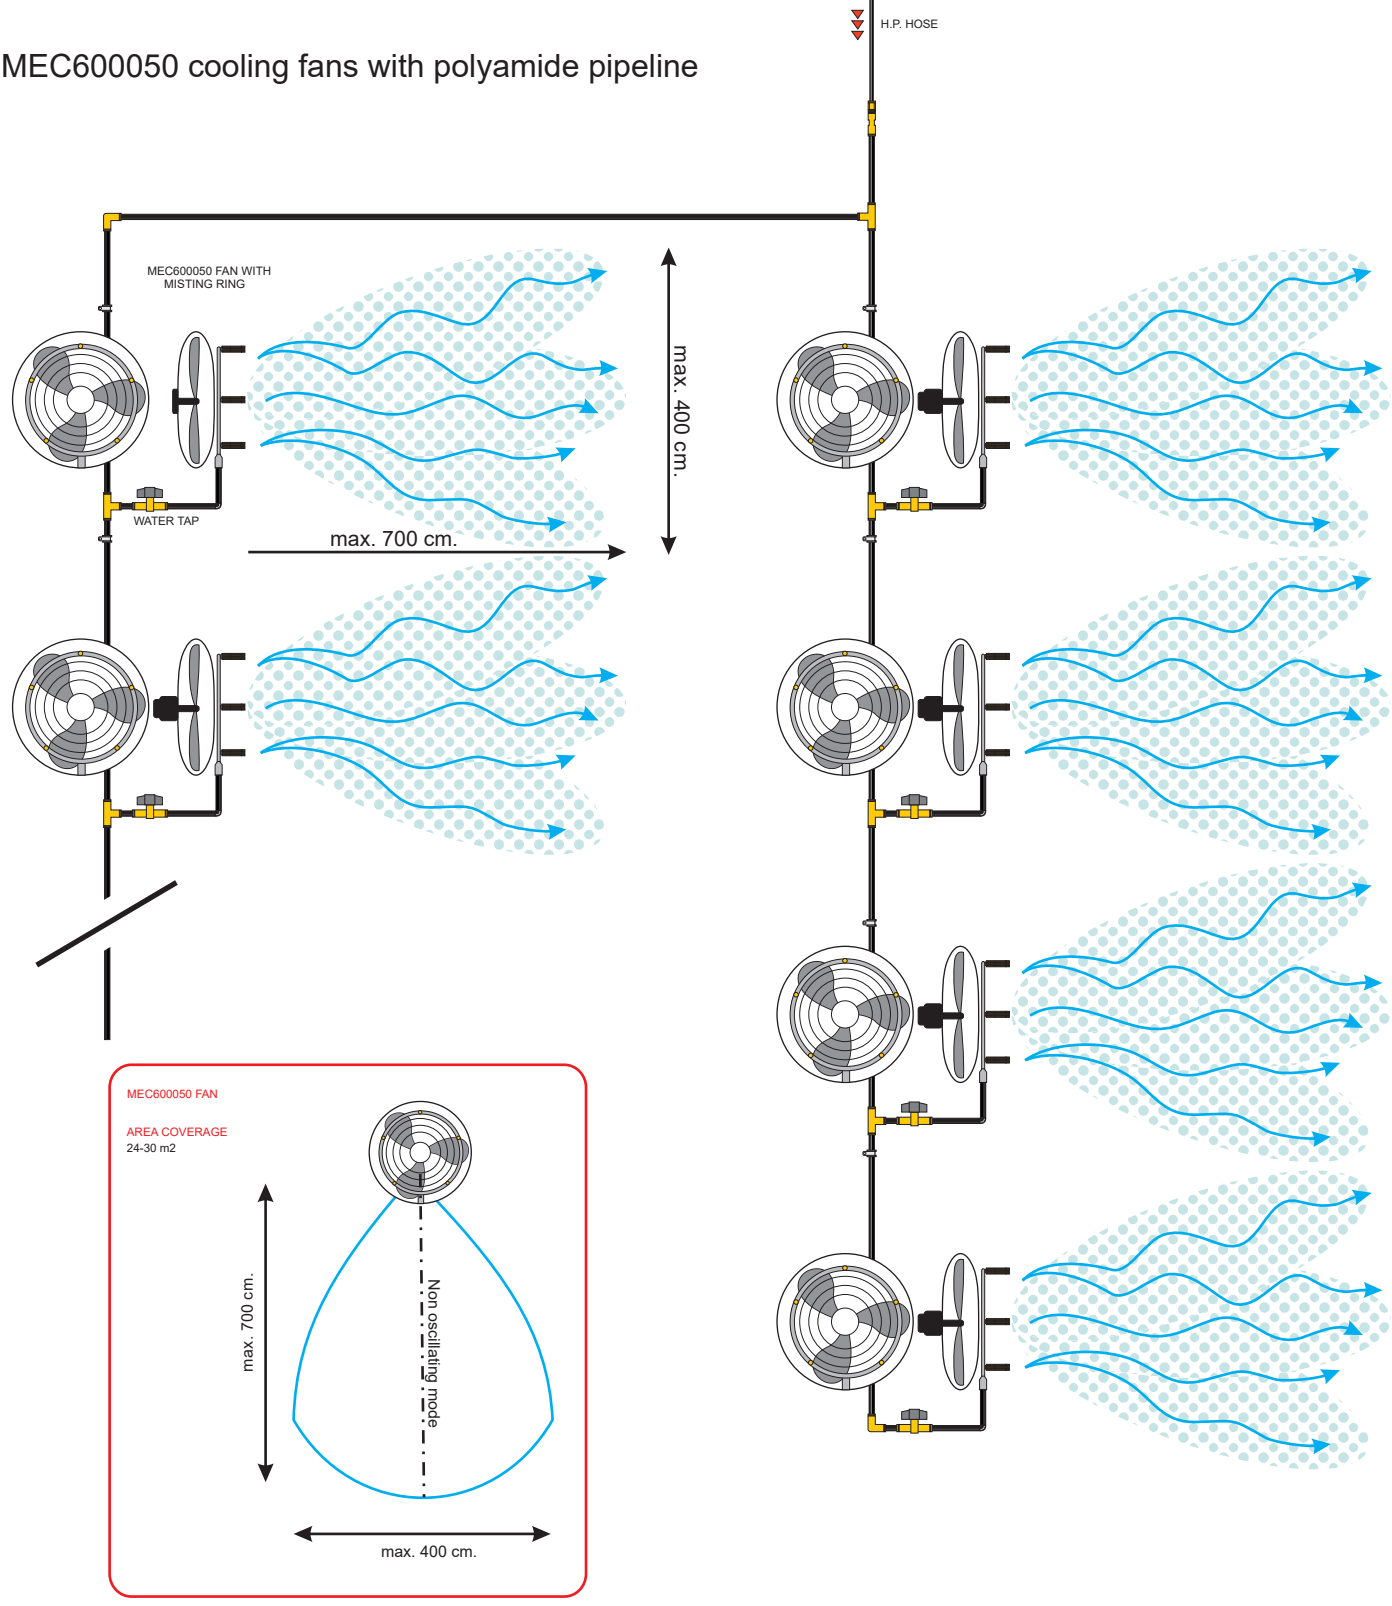

Mounting layout example



H.P. HOSE

EuroJet

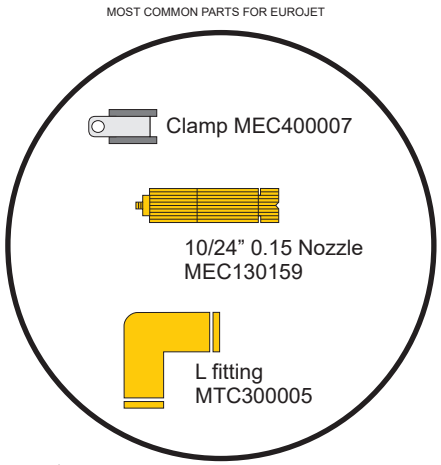

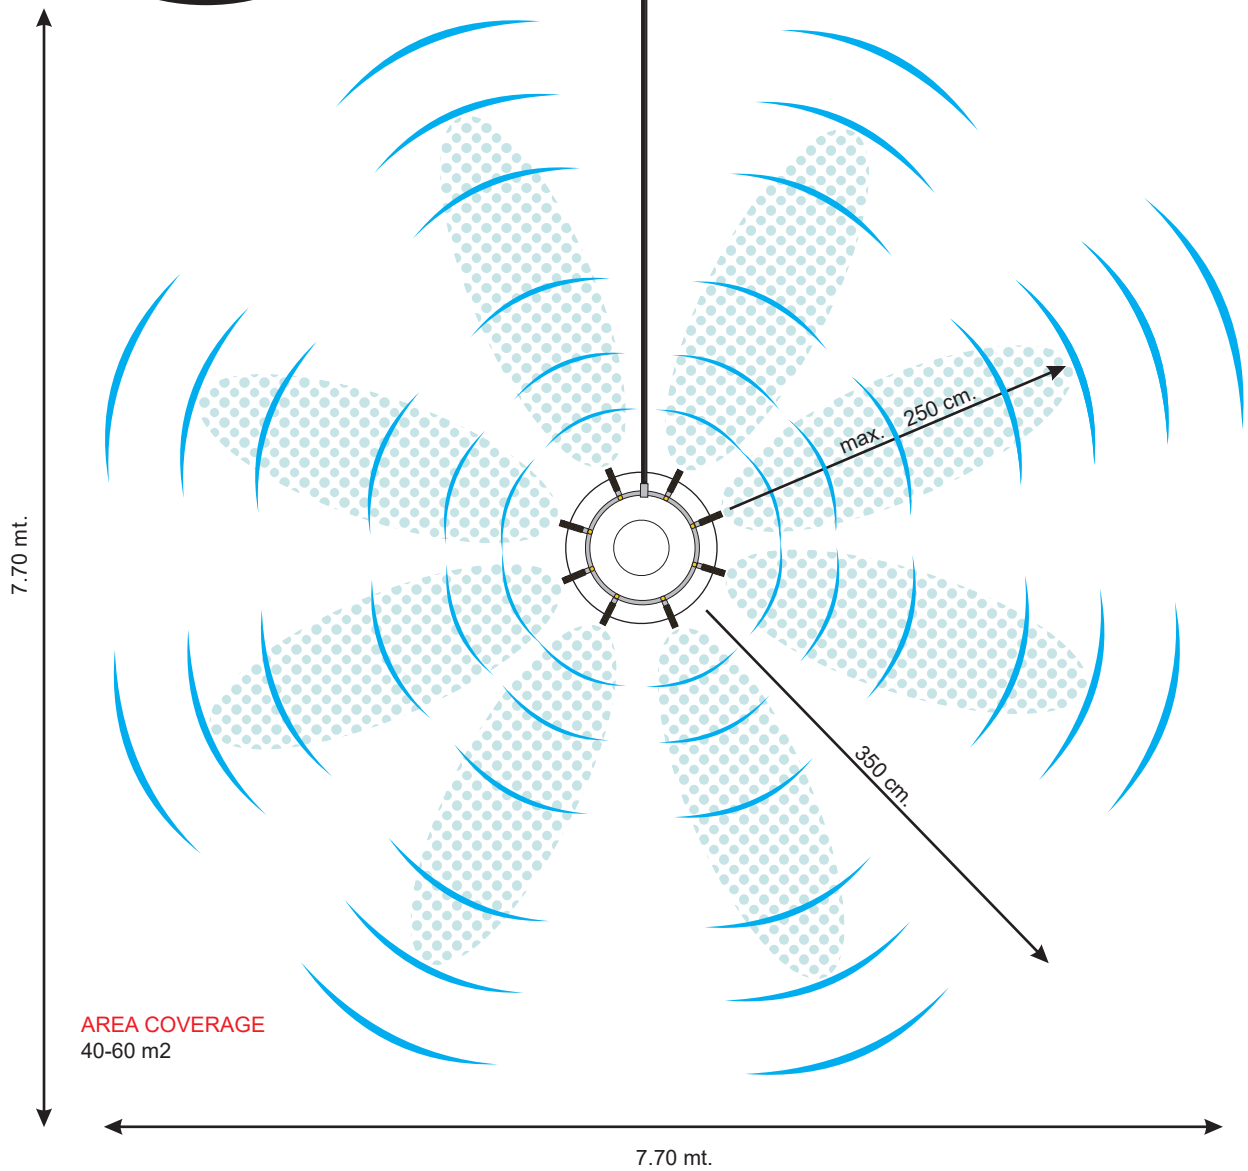

Mounting layout example
Schema esemplificativo di installazione

MEC600162 industrial cooling fan

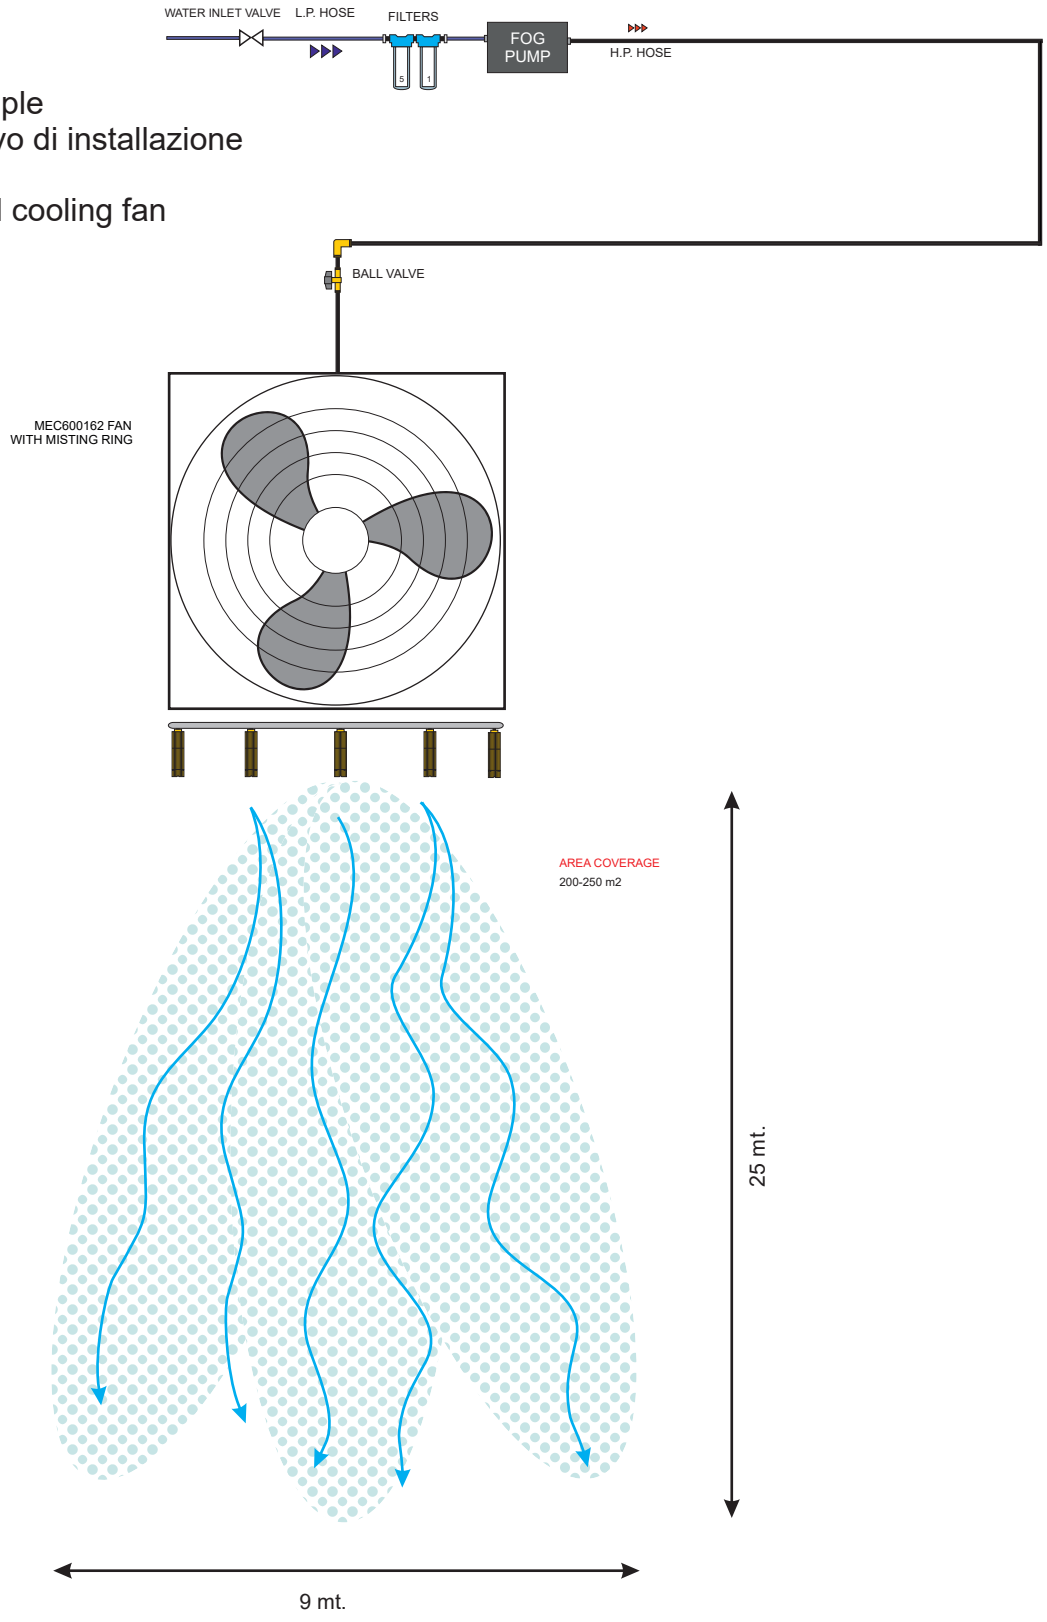

1) Fans should be mounted 25 meters far from each other
2) Fans must be mounted at 450 or more cm. height from floor

Mounting layout example
Humidification polyammide pipes line

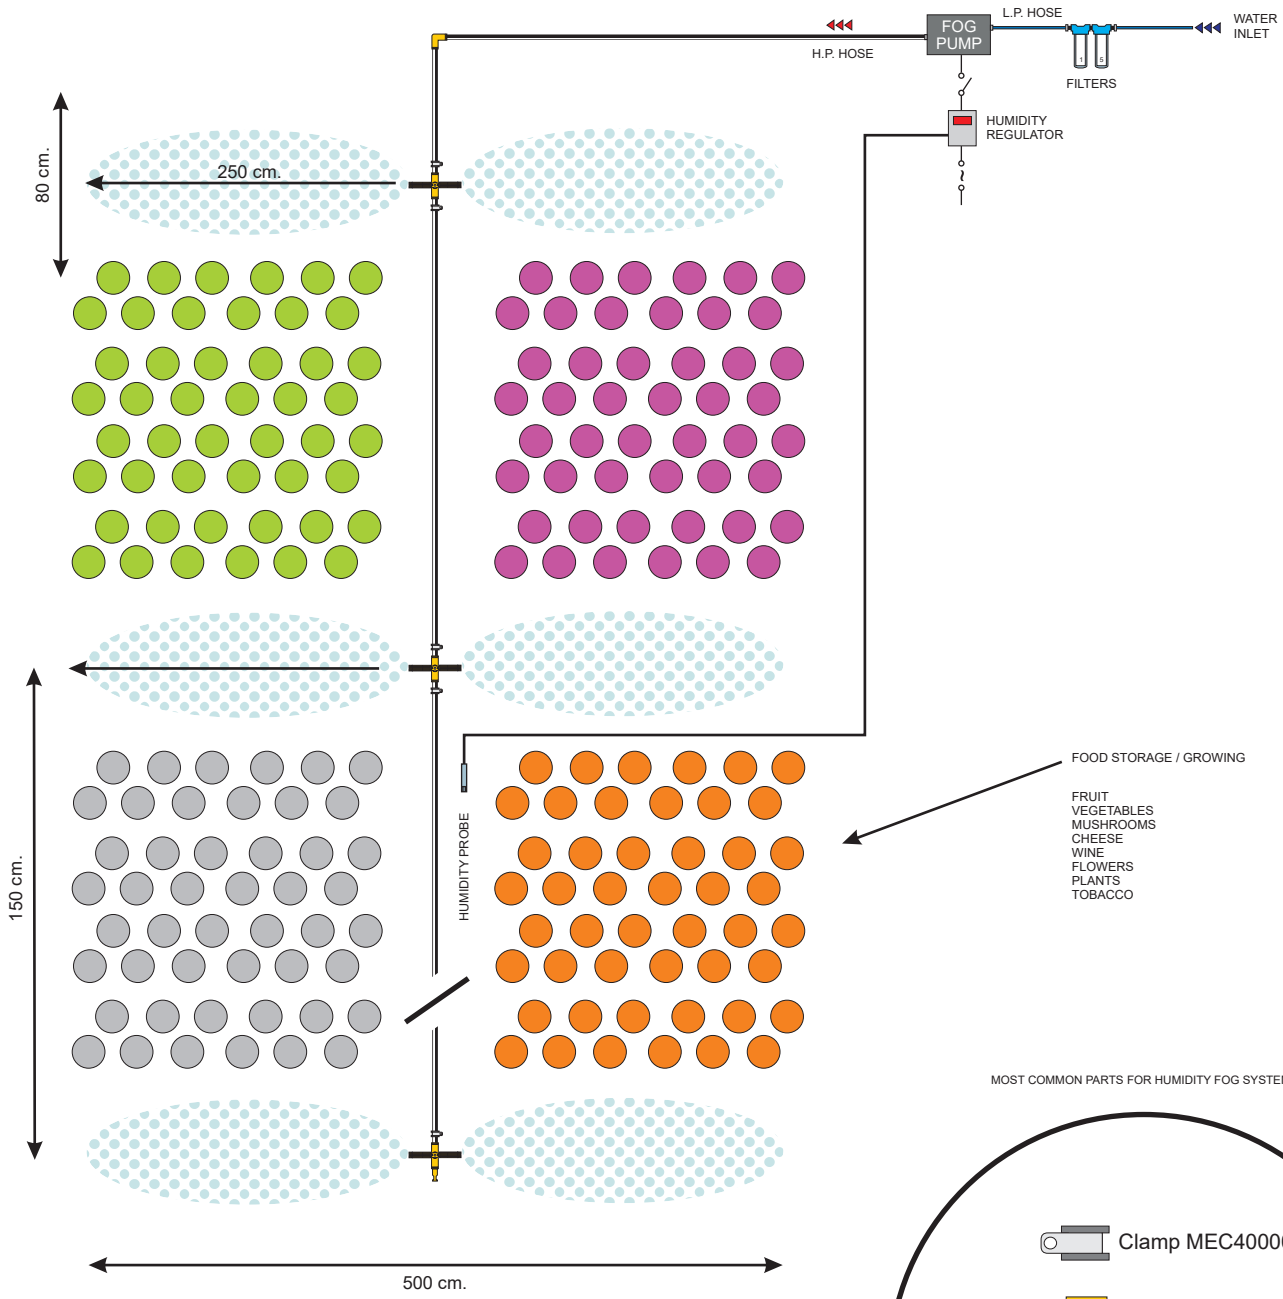

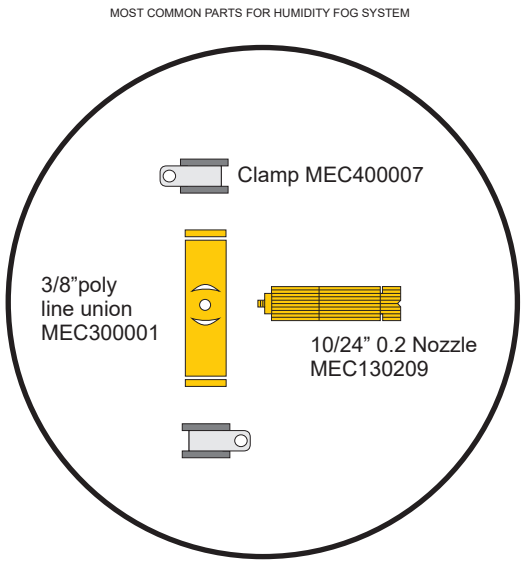

Mounting layout example with multiple humidification polyamide pipelines
Requires: VAR pump + Humidity Controllers

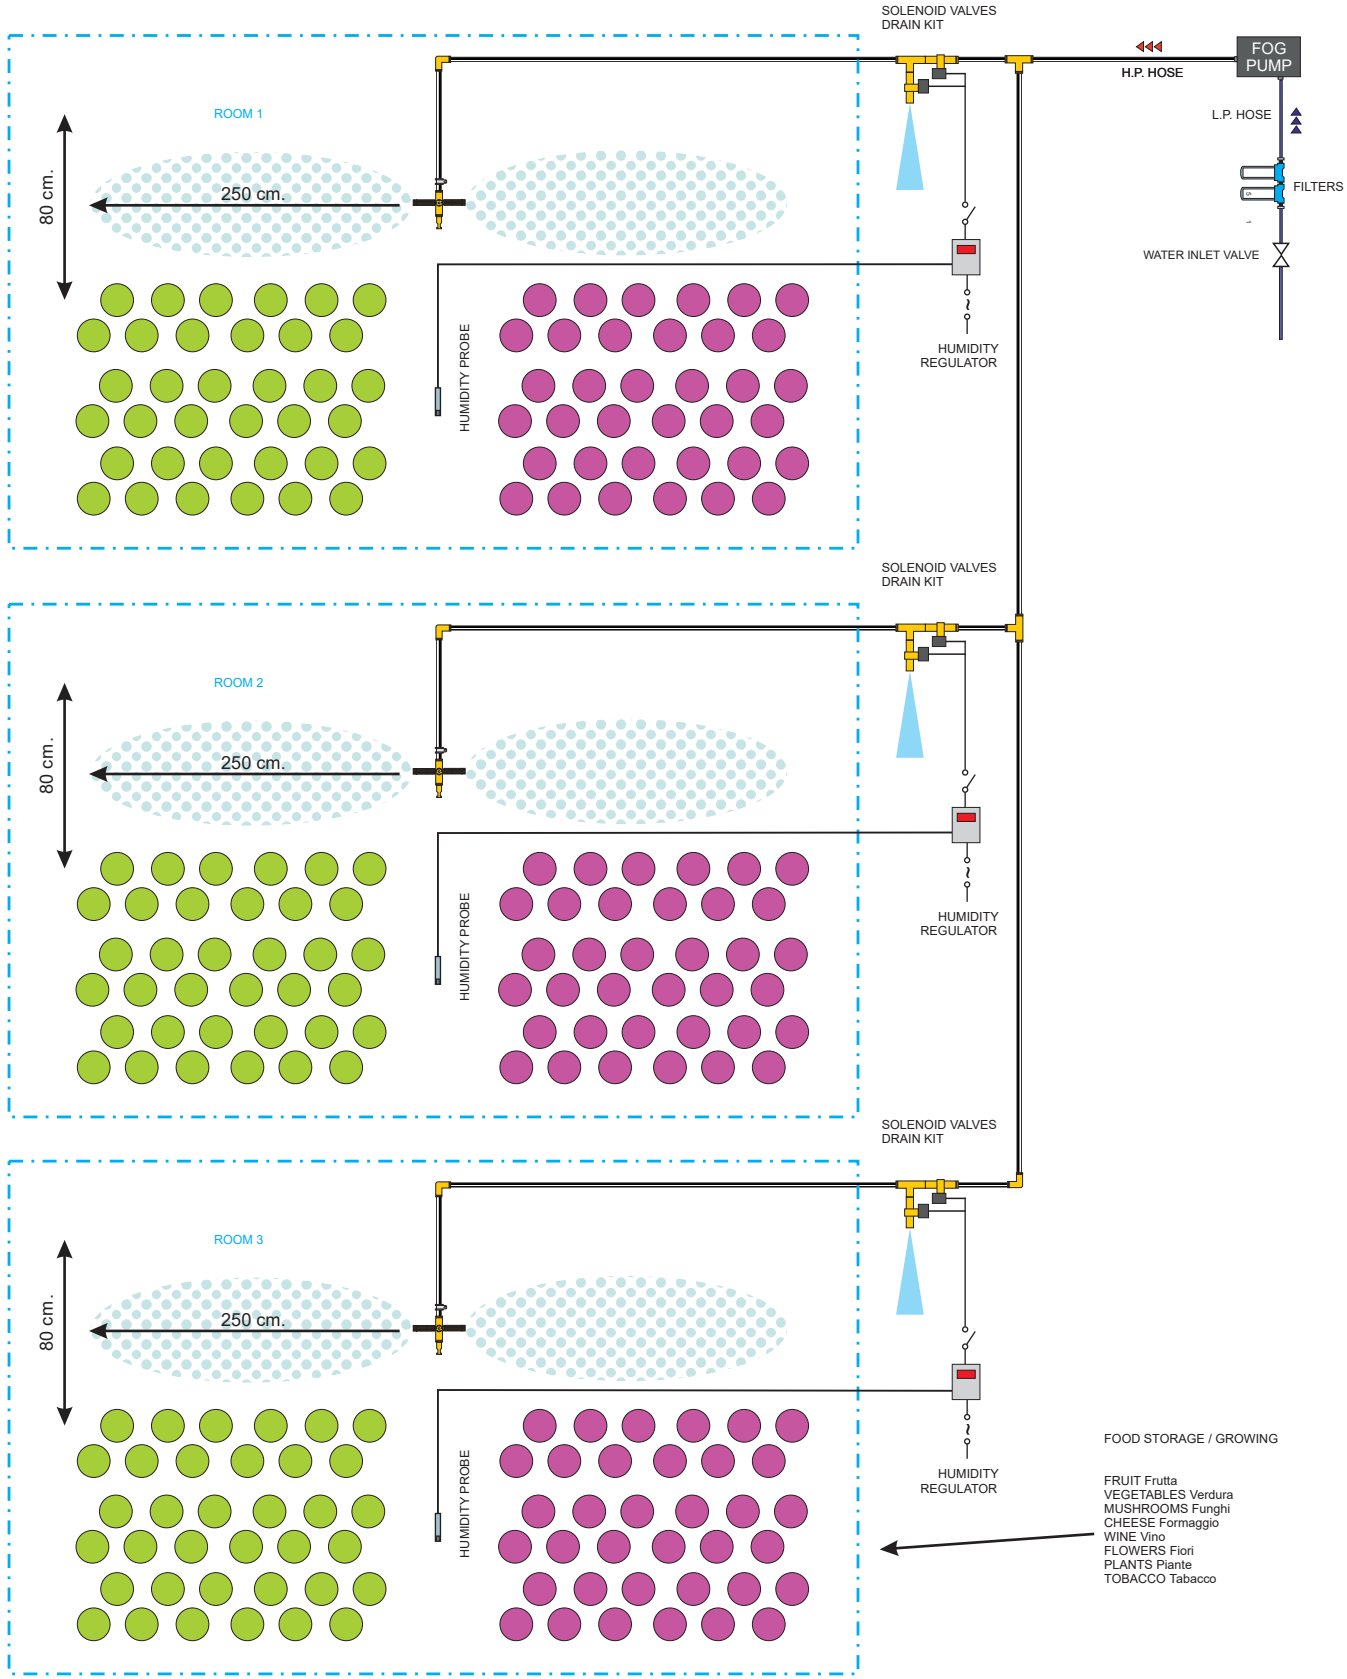

Mounting layout example
Totem and Arch

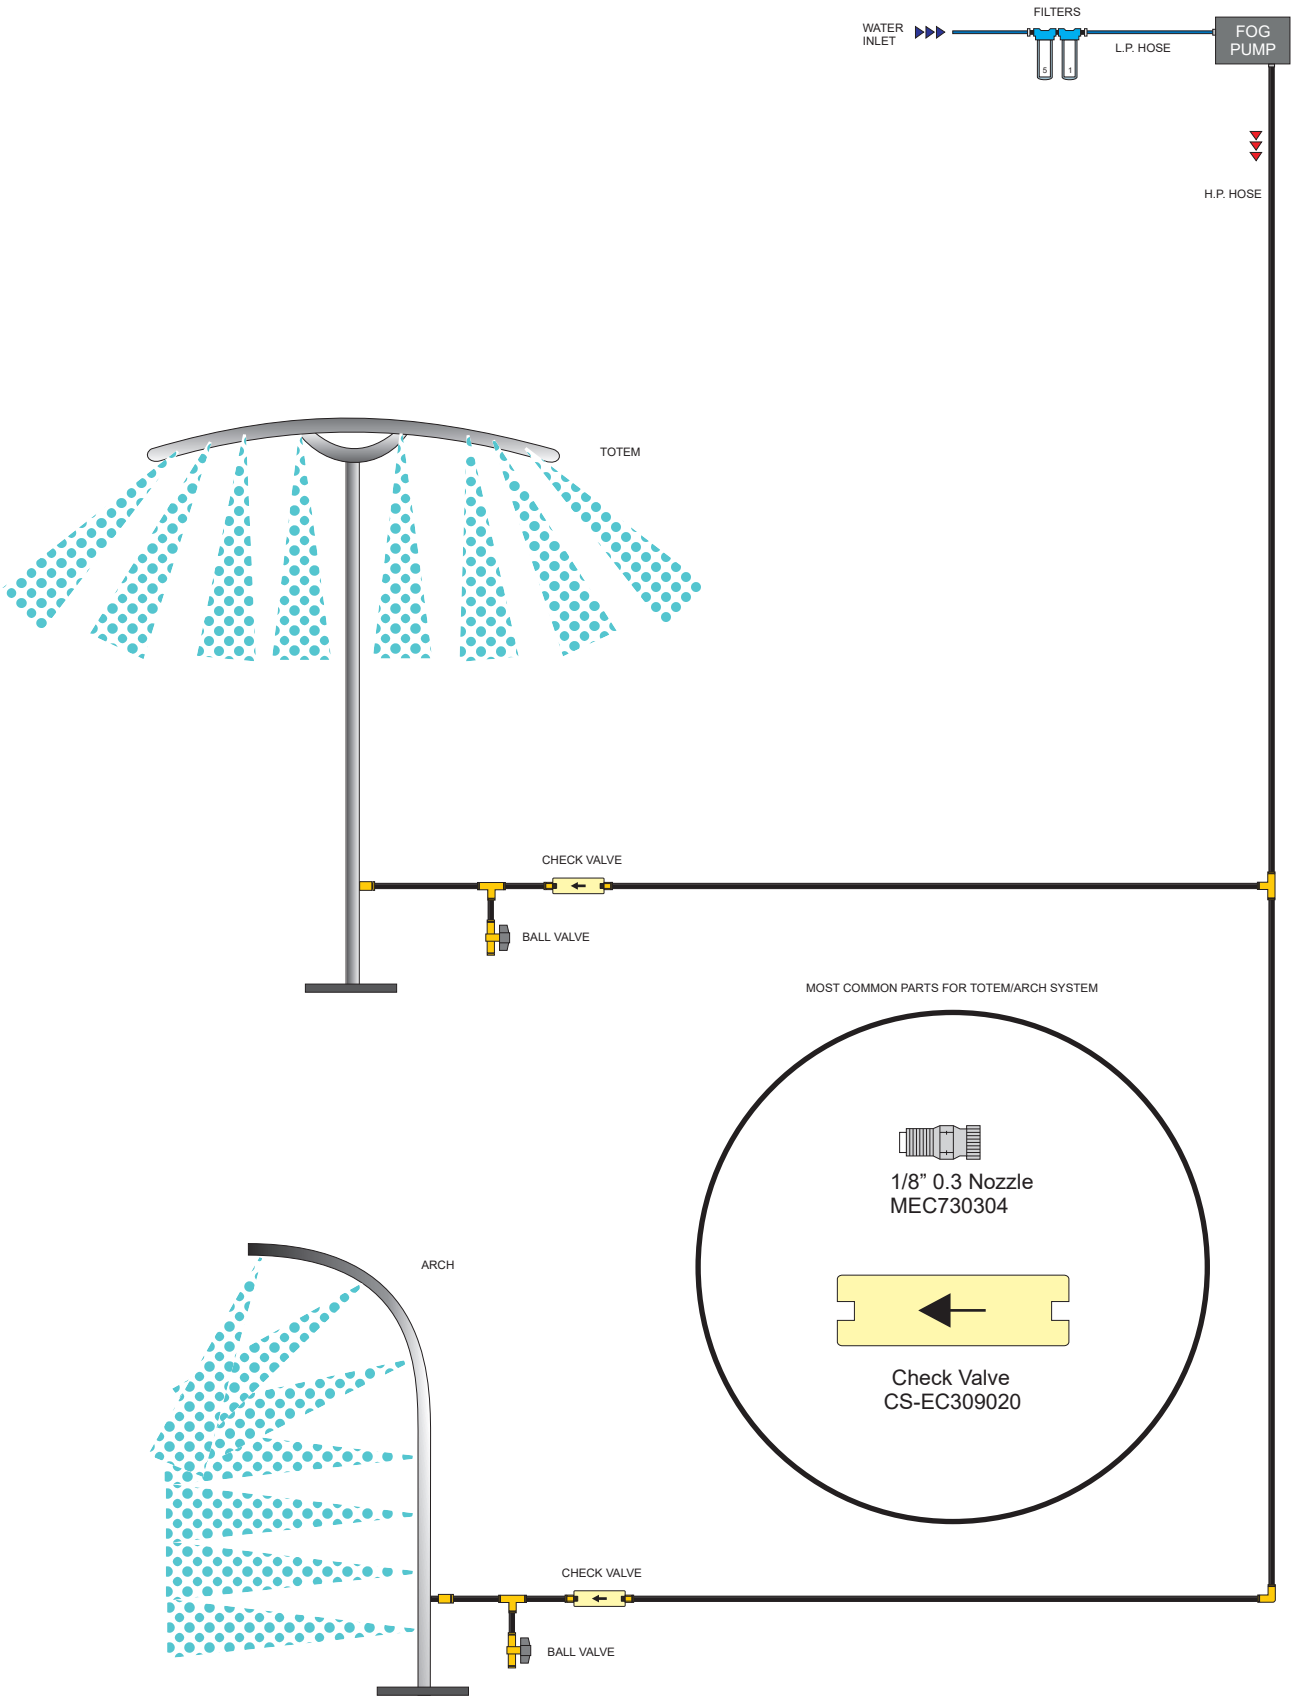

Mounting layout example
Indoor Cooling with Steinless Steel or Polyamide pipes line

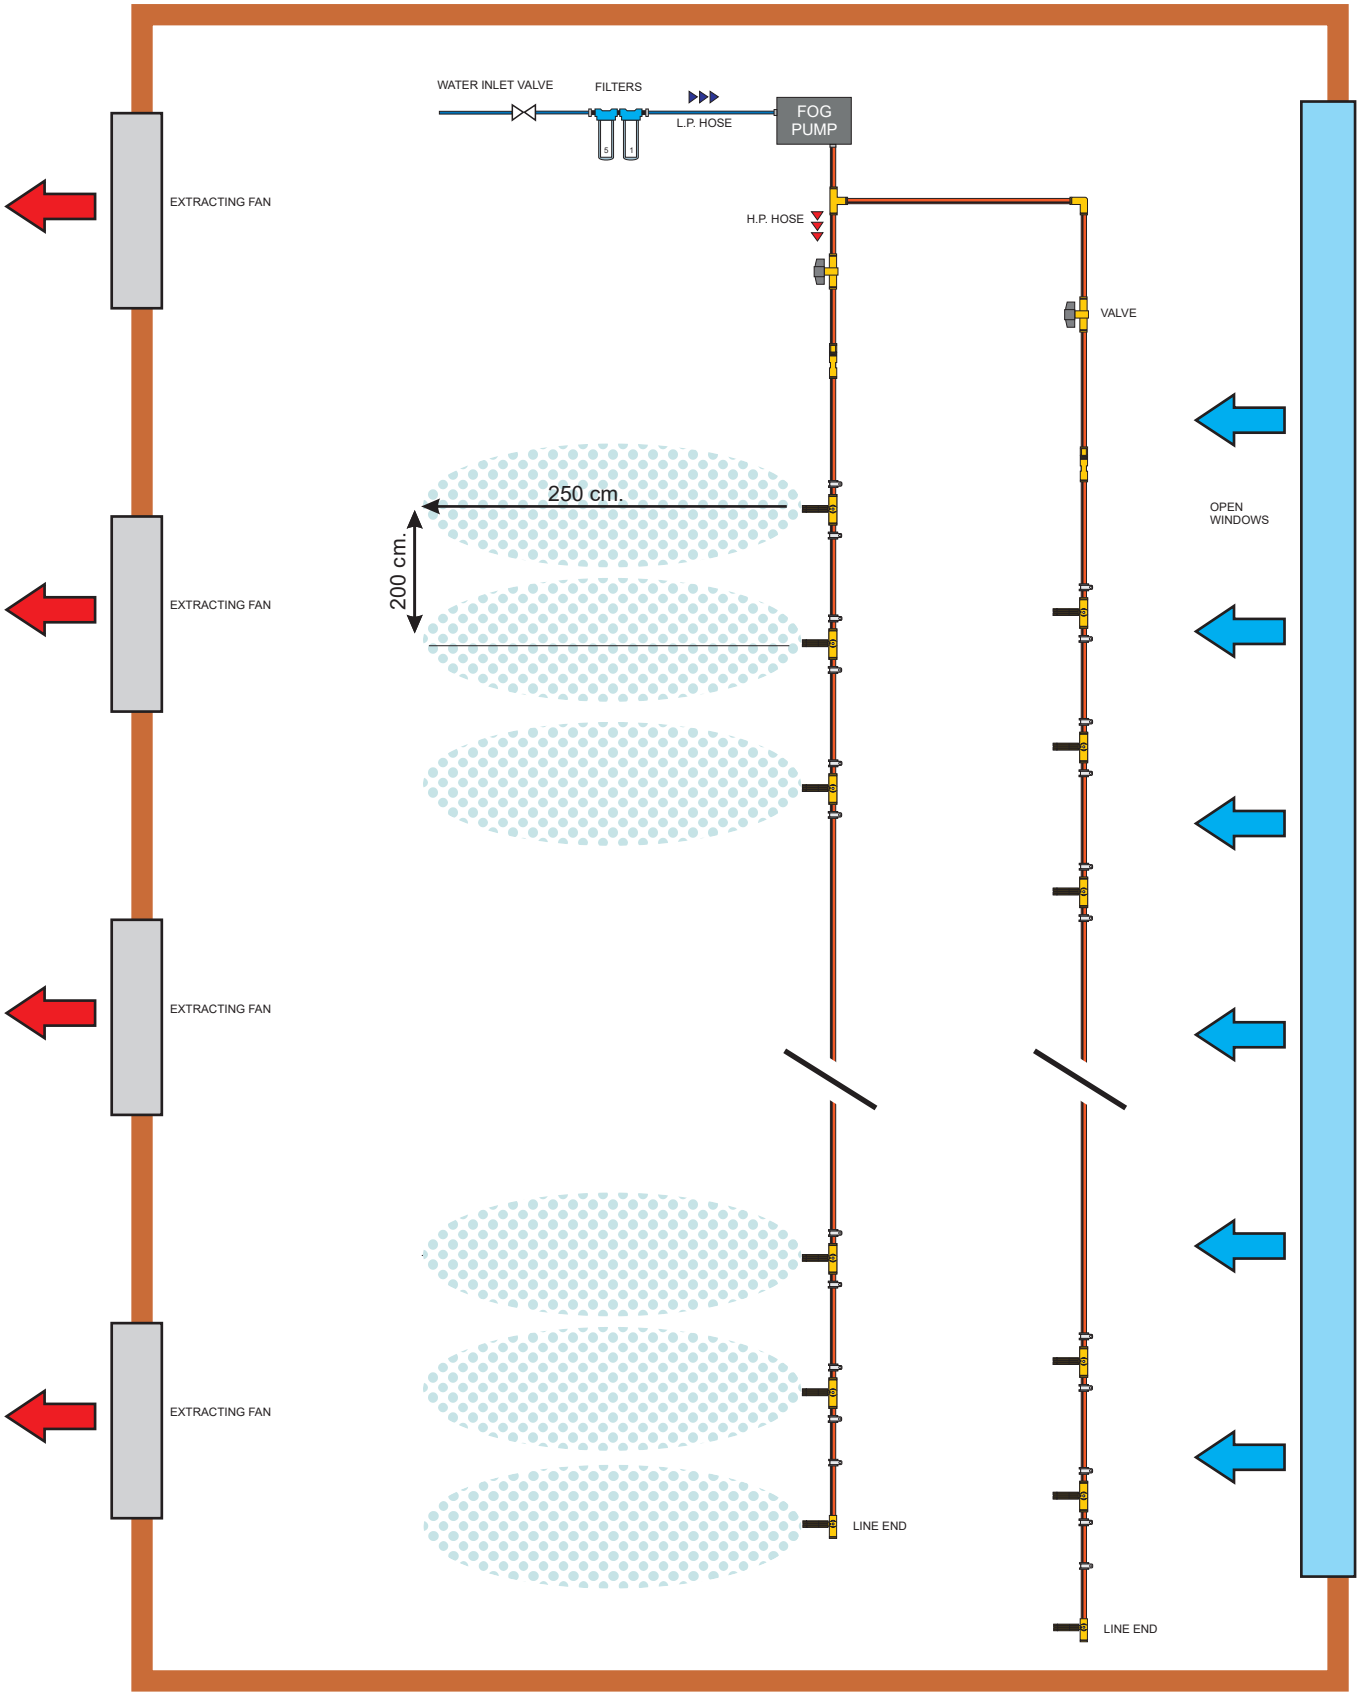

Mounting layout example with MEC100004 dosing pump

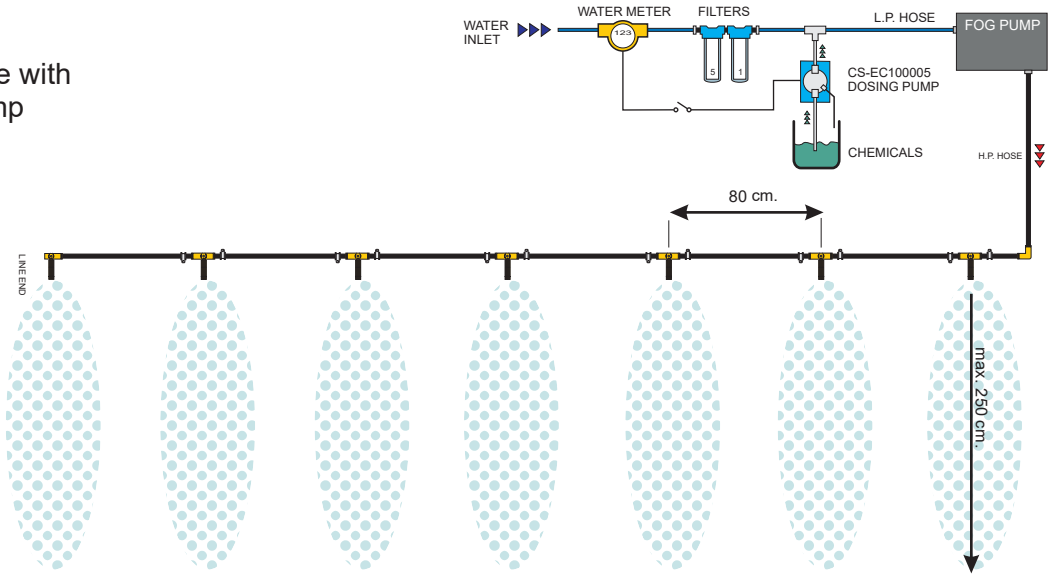

Mounting layout example with MEC100005 dosing pump

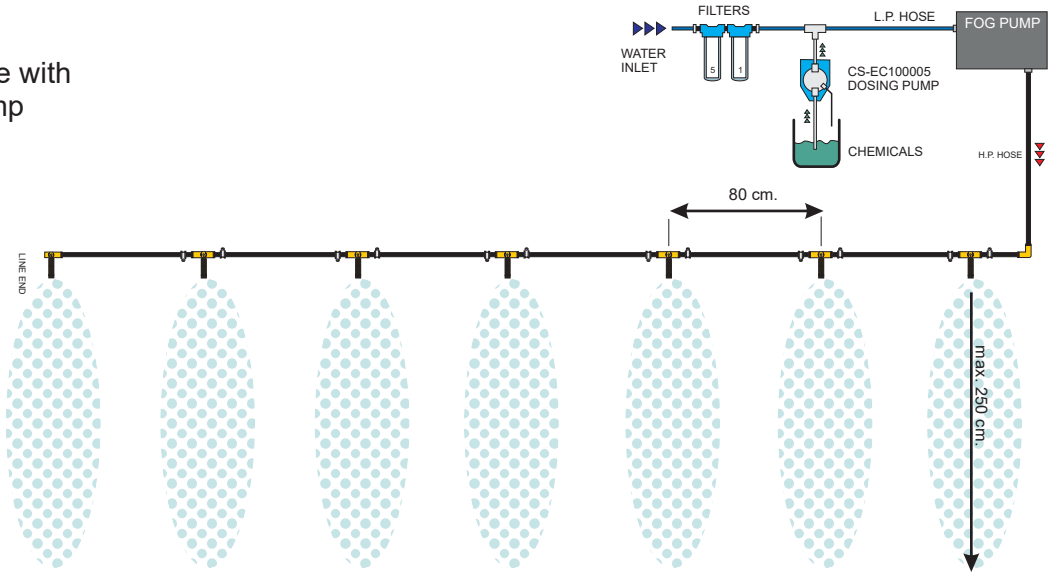

Mounting layout example with MEC100006 dosing pump

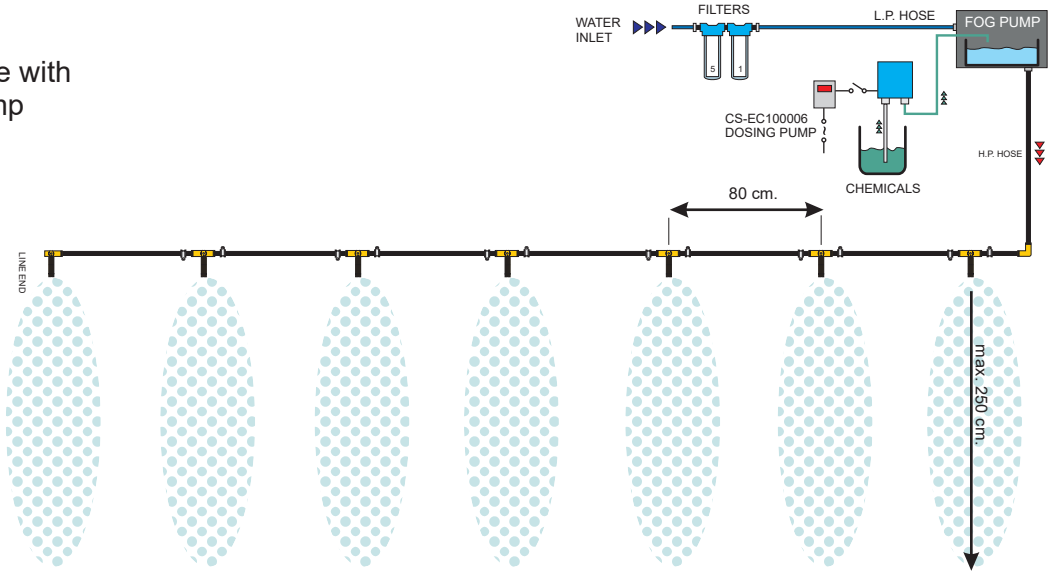

Mounting layout example
AIRMIST humidification system
Air/Water humidifier + Humidity Probe required

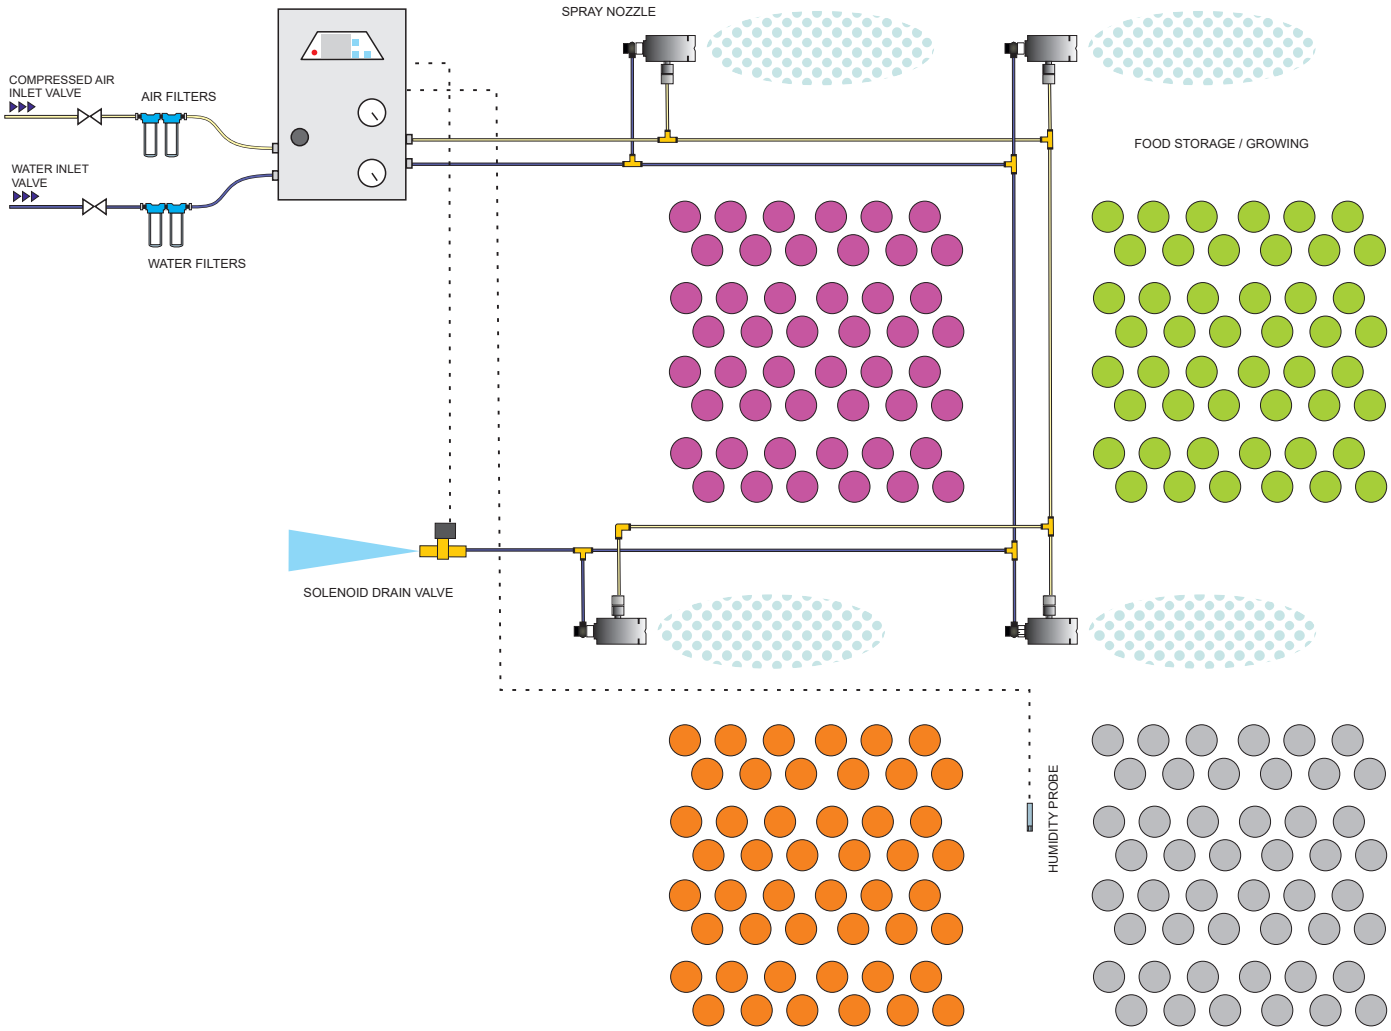

MOST COMMON PARTS FOR HUMIDITY FOG SYSTEM

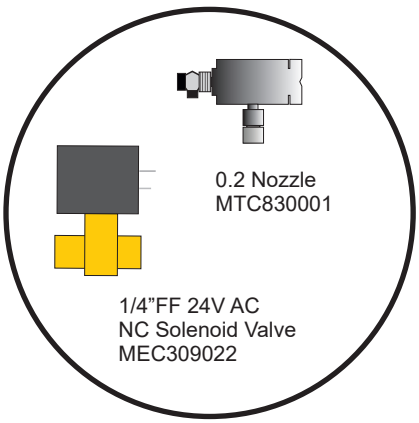

Table: Flow rate (LPM) (GPH)versus operating pressure (BAR) (PSI) w ith HR-NOZZLE2

Water pressure	Air pressure					
BAR / PSI	BAR/PSI	2/29	3/43.5	4/58	5/72.5	6/87
2 / 29	LPM	0,075	0,057	0,025	0,013	0,005
2 / 29	GPH	1,189	0,903	0,396	0,206	0,079
3 / 43.5	LPM	0,090	0,075	0,052	0,027	0,010
3 / 43.5	GPH	1,427	1,189	0,824	0,428	0,159
4 / 58	LPM	0,118	0,110	0,094	0,078	0,058
4 / 58	GPH	1,870	1,744	1,490	1,236	0,919

* measurement accuracy ± 10%

AHU Mounting layout example with POLARIS LSP or EVOLUTION VAR pump

DEC: Humidification / Direct Evaporative cooling + IEC: Indirect Evaporative Cooling

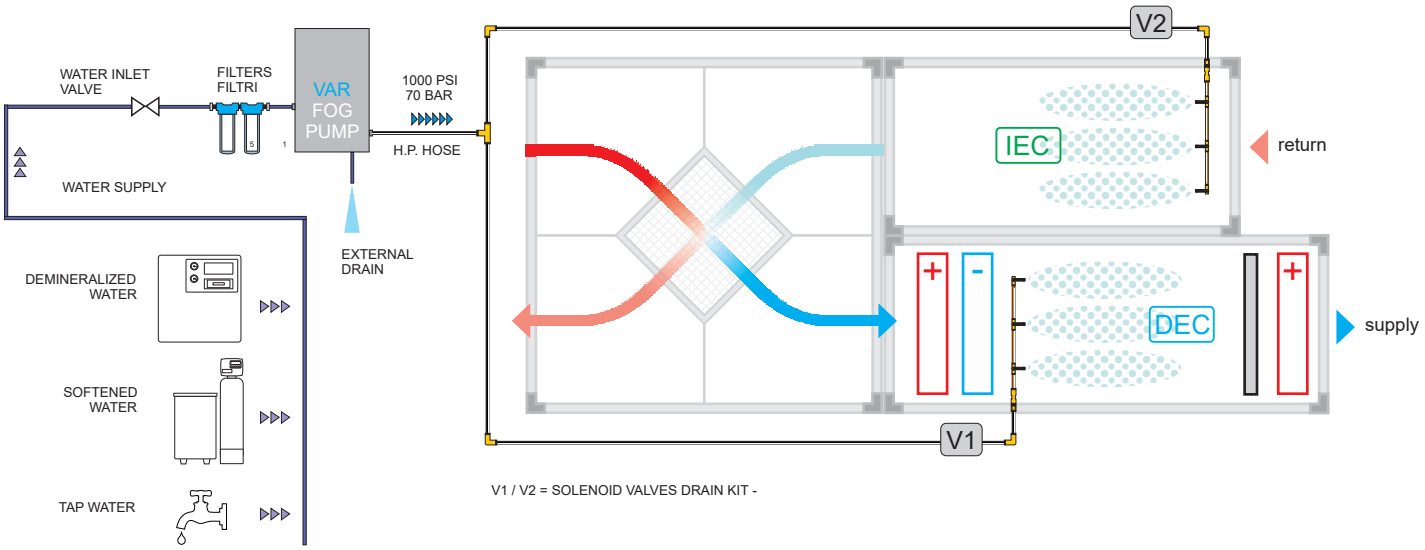

V1 / V2 = SOLENOID VALVES DRAIN KIT -

AHU Mounting layout example with EVOLUTION or PREMIUM PLUS pump

DEC: Humidification / Direct Evaporative cooling

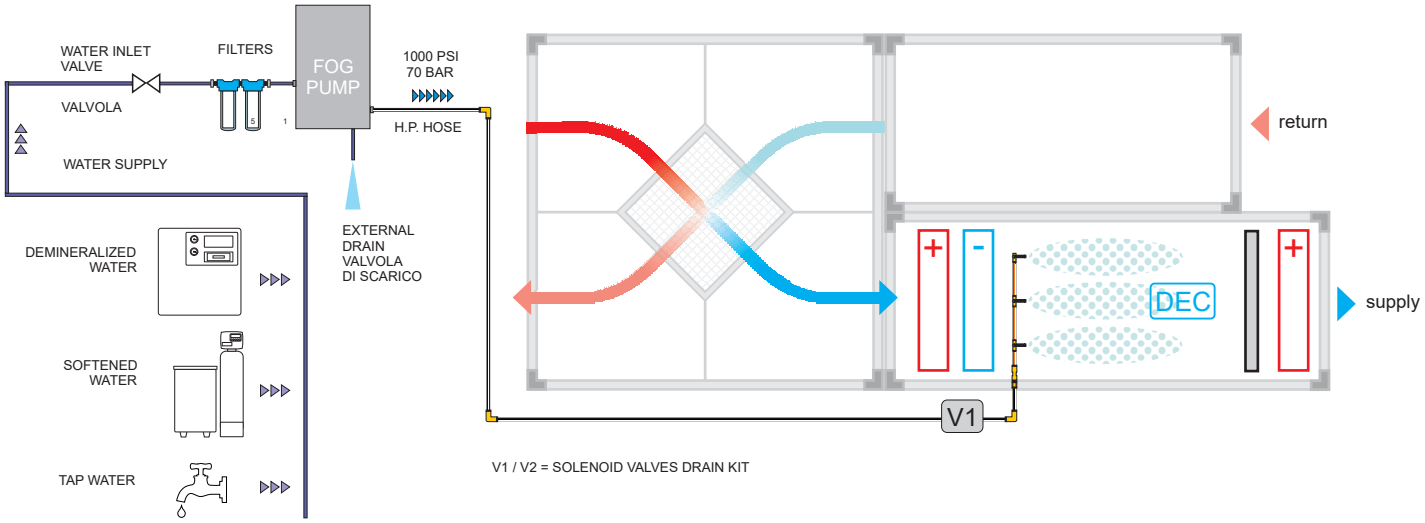

V1 / V2 = SOLENOID VALVES DRAIN KIT

Nozzle RACK examples

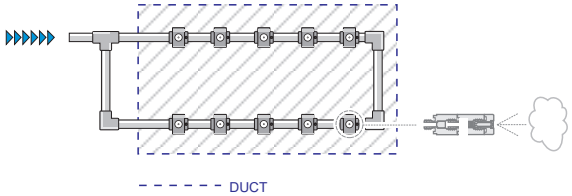

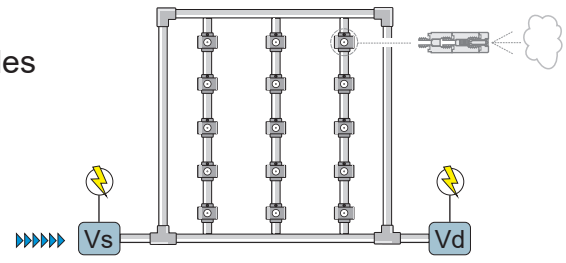

Vs / Vd = SOLENOID VALVES DRAIN KIT

TC4-RACK

AHU Mounting layout example with
NT-FOG VAR / PLC / TC4-RACK control software

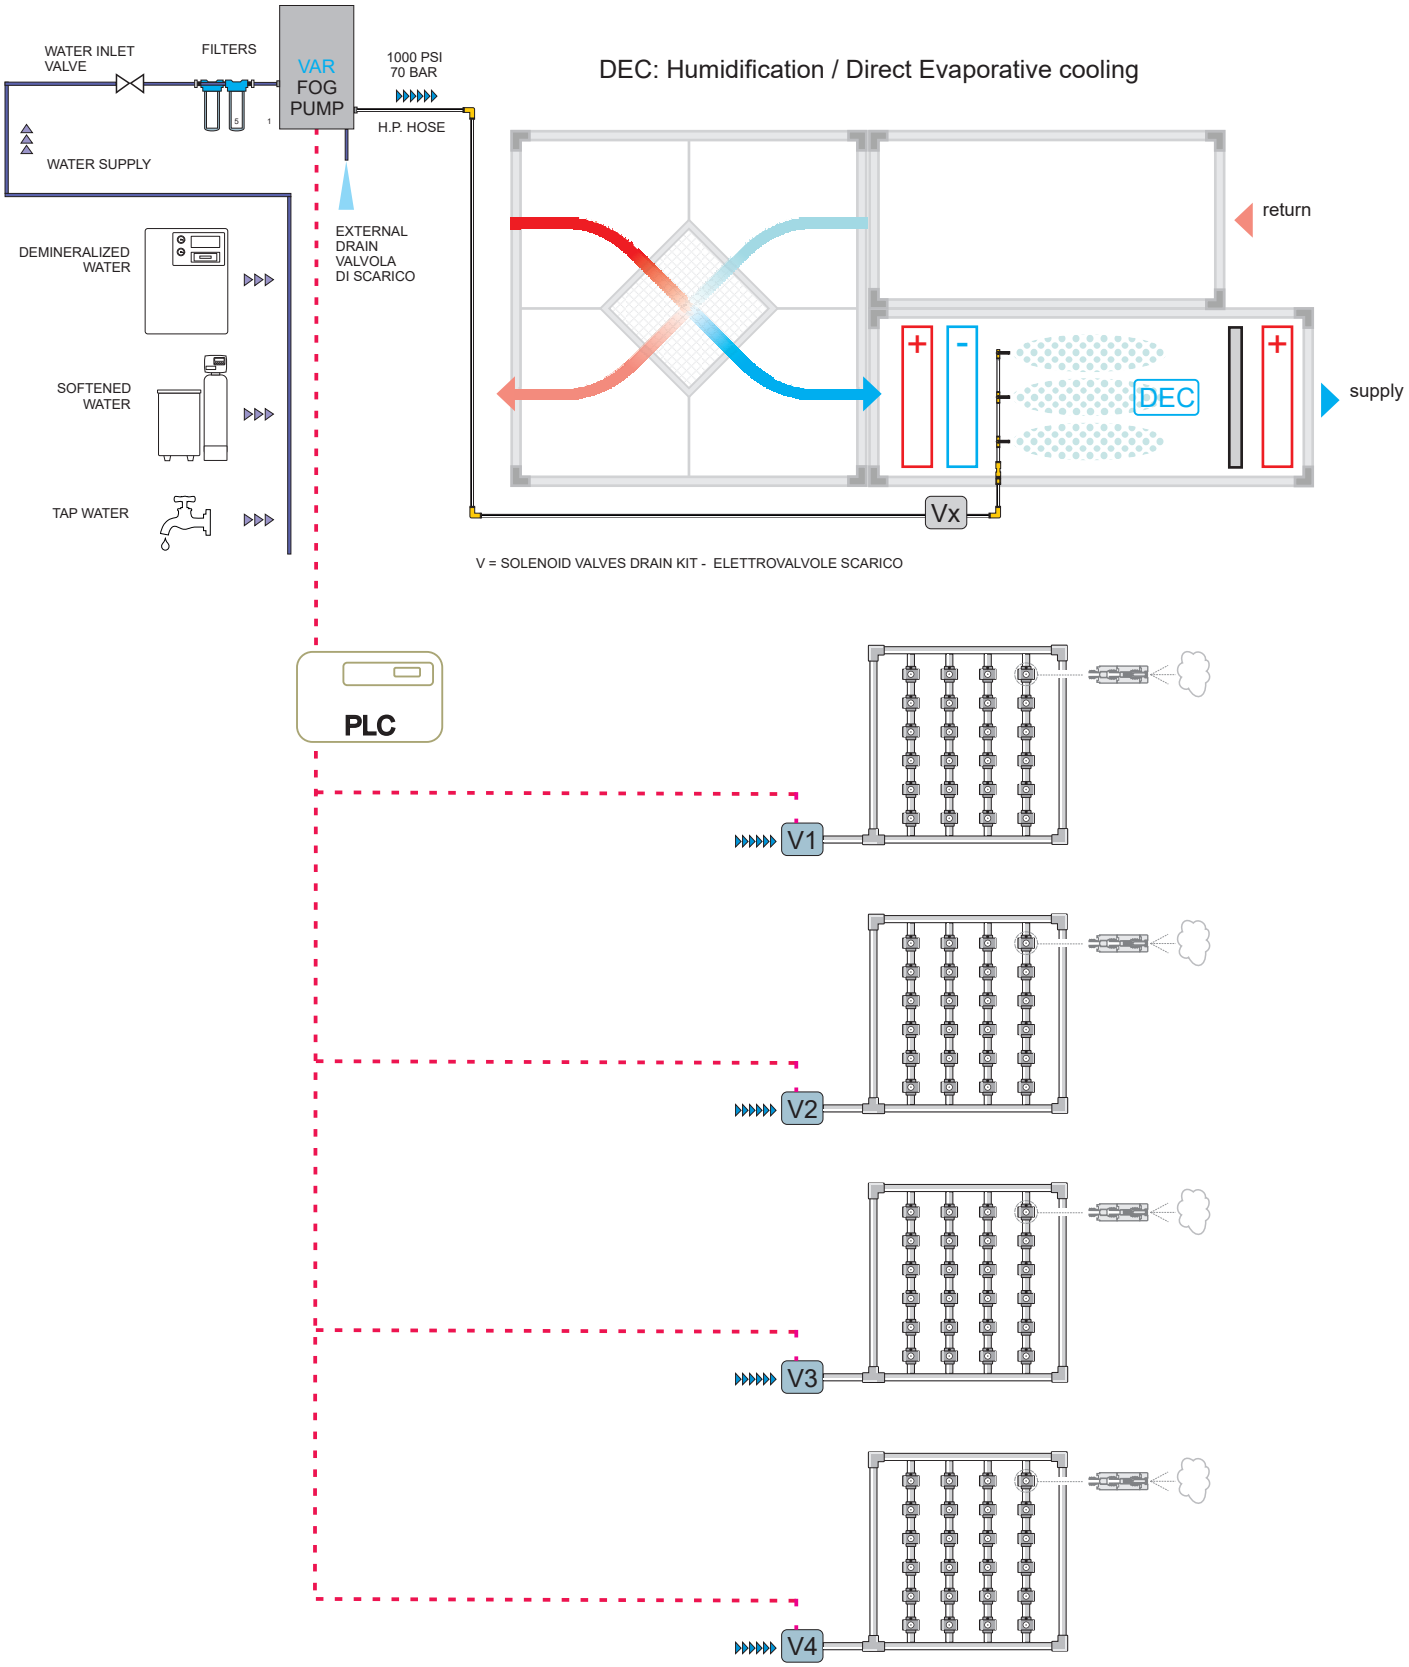

Mounting layout example
NT-FOG OUTLET Connections up to 21 lpm to two lines 3/8"

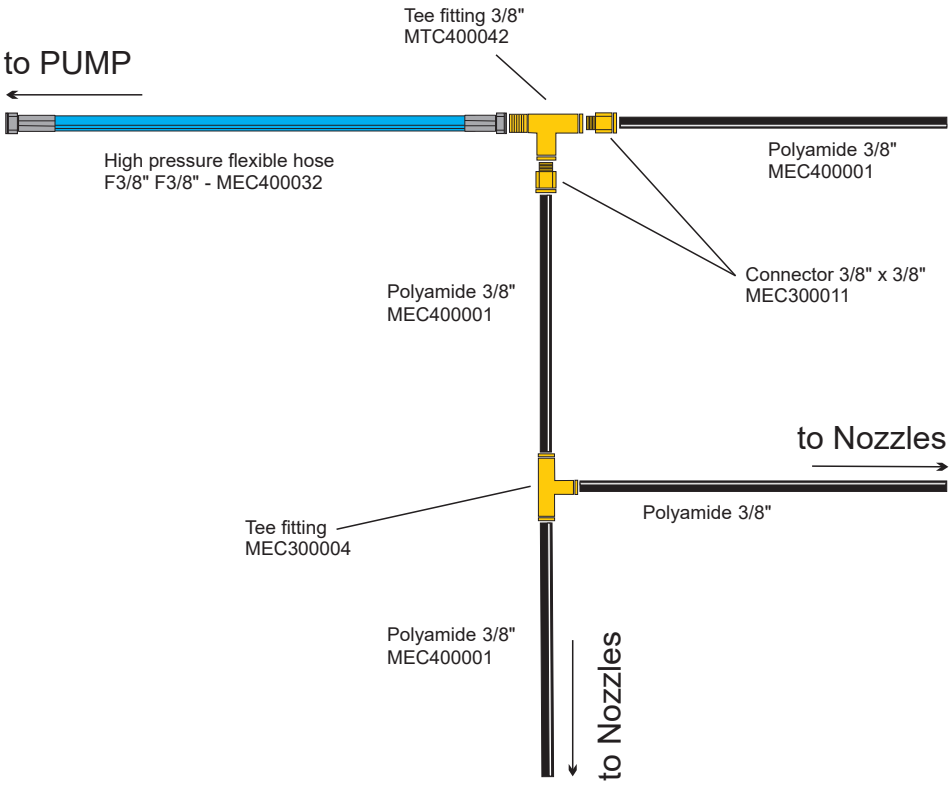

Mounting layout example
NT-FOG OUTLET Connections up to 21 lpm to one line 1/2"

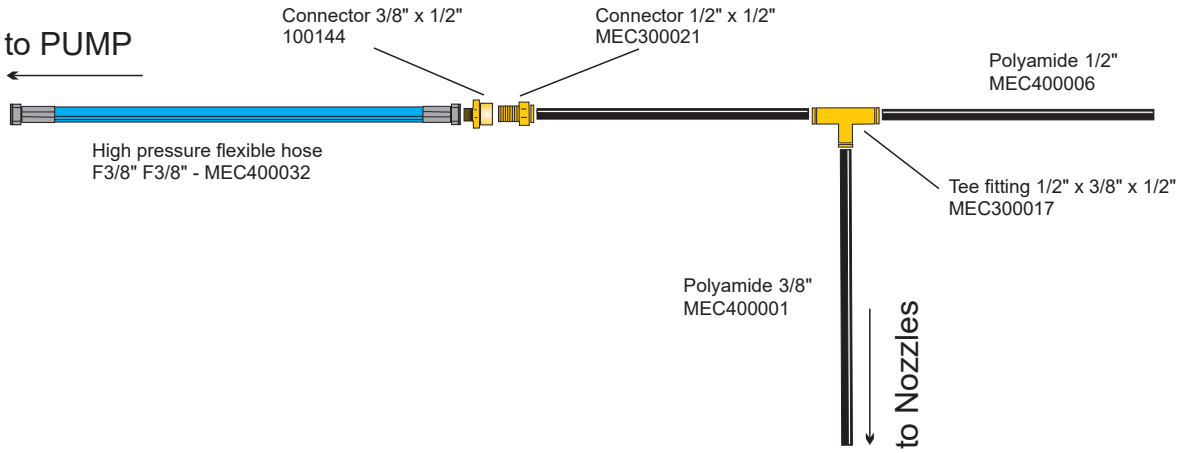

Mounting layout example
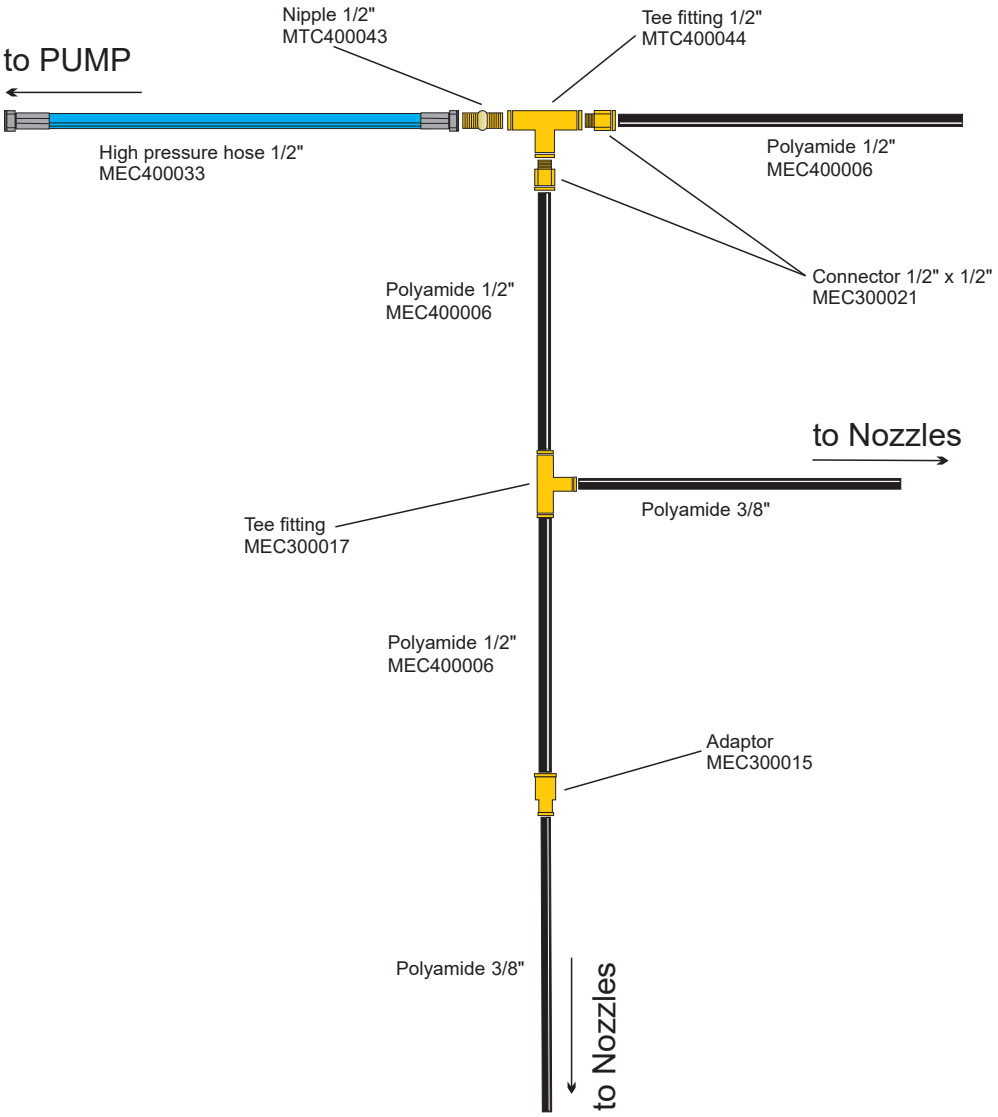
NT-FOG OUTLET Connections over 21 lpm to two lines 1/2"